

XT110C - XT111C

Single Stage Digital Controller with Multi Probe Input



1. GENERAL WARNING

1.1 PLEASE READ BEFORE USING THIS MANUAL

- This manual is part of the product and should be kept near the instrument for easy and quick reference.
- The instrument shall not be used for purposes different from those described hereunder. It cannot be used as a safety device.
- Check the application limits before proceeding.

1.2 SAFETY PRECAUTIONS

- Check the supply voltage is correct before connecting the instrument.
- Do not expose to water or moisture: use the controller only within the operating limits avoiding sudden temperature changes with high atmospheric humidity to prevent formation of condensation
- Warning: disconnect all electrical connections before any kind of maintenance.
- The instrument must not be opened.
- In case of failure or faulty operation send the instrument back to the distributor or to "DIXELL s.r.l." (see address) with a detailed description of the fault.
- Consider the maximum current which can be applied to each relay (see Technical Data).
- Ensure that the wires for probes, loads and the power supply are separated and far enough from each other, without crossing or intertwining.
- In case of applications in industrial environments, the use of mains filters (our mod. FT1) in parallel with inductive loads could be useful.

2. GENERAL DESCRIPTION

The XT110C and XT111C are single-stage ON/OFF controllers for temperature, humidity and pressure applications with direct or inverse action, user-selectable. The analogue input type can be set by parameter between the following, according to the model:

- PTC, NTC;
- PTC, NTC, Pt100, Thermocouple J, K, S;
- 4+20mA, 0+1V, 0+10V.

3. FIRST INSTALLATION

3.1 PROBE SETTING

The pre-set probe type is written on the label of the instrument, see picture. If it is different from the probe that


has been used, set the probe following procedure below

3.1.1 How to set the probe.

- Enter the programming menu by pressing the **SET + ▾** for 3s.
- Select the **Pbc (Probe configuration)** parameter and push the **SET** key.
- Set the kind of probe:
 - Controller for temperature:** Pt= Pt100, J = J thermocouple, c = K thermocouple, S = S thermocouple; Ptc = PTC; ntc = ntc.
 - Controller with current or voltage inputs:** cur=4+20mA, 0-1=0+1V, 10=0+10V
- Push the **SET** key to confirm it.
- Switch the controller off and on again.

NOTE: Before proceeding check and, if necessary, set with appropriate values the **Minimum Set Points (LS1 e LS2)** and **Maximum Set Points (US1 e US2)**. See also the paragraphs concerning the programming.

4. FRONT PANEL COMMANDS

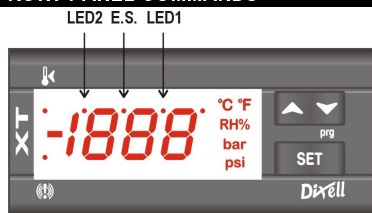

SET: To display and modify target set point; in programming mode it selects a parameter or confirm an operation.

TO SWITCH THE INSTRUMENT ON/OFF: If the function is enabled (par. onF=yES), by pressing the SET key for more

than 4s the controller is switched OFF. To switch the instrument on again press the SET key.

- UP:** in programming mode it browses the parameter codes or increases the displayed value. Hold it pressed for a faster change
- DOWN:** in programming mode it browses the parameter codes or decreases the displayed value. Hold it pressed for a faster change

KEY COMBINATIONS:

- ▲ + ▾** To lock & unlock the keyboard.
- SET + ▾** To enter in programming mode.
- SET + ▲** To return to the room temperature display.

4.1 USE OF LEDS

A series of light points on the front panels is used to monitor the loads controlled by the instrument. Each LED function is described in the following table.

| LED | MODE | FUNCTION |
|------|----------|---|
| | ON | Output relay enabled |
| LED1 | Flashing | - Programming Phase (flashing with LED2) |
| LED2 | Flashing | - Programming Phase (flashing with LED1) |
| E.S. | ON | Energy saving activated by digital input |
| | ON | - ALARM signal - In "Pr2" indicates the parameter is also present in "Pr1" |

4.2 TO SEE THE SETPOINT

- Push and release the **SET** key to see the Set point value;
- To come back to the normal display push again the **SET** key or wait 10s.

4.3 TO CHANGE THE SETPOINT

- Hold pushed the **SET** key for 3s to change the Set point value;
- The value of the set point will be displayed and the LED1 & 2 start blinking;
- To change the Set value push the **▲** or **▾** arrows within 10s.
- To memorise the new set point value push the **SET** key again or wait 10s.

4.4 TO ENTER THE PARAMETERS LIST "PR1"

To enter the parameter list "Pr1" (user accessible parameters) operate as follows:

- Push for 3s the **SET + ▾** keys (LED1 & 2 start blinking).
- The controller will display the first parameter present in the Pr1 menu.

4.5 TO ENTER THE PARAMETERS LIST "PR2"

The "Pr2" parameter list contains the configuration parameters. A security code is required to enter it.

- Enter the "Pr1" level, see above paragraph.
- Select "Pr2" parameter and press the **"SET"** key.
- The **"PAS"** flashing message is displayed, shortly followed by **"0 -"** with a flashing zero.
- Use **▲** or **▾** to input the security code in the flashing digit; confirm the figure by pressing **"SET"**.

The security code is "321".

- If the security code is correct the access to "Pr2" is enabled by pressing **"SET"** on the last digit.

Another possibility is the following:

After switching ON the instrument, within 30 seconds, push **SET + ▾** keys together for 3s: the Pr2 menu will be entered.

4.6 HOW TO MOVE A PARAMETER FROM THE "PR2" MENU TO "PR1" AND VICEVERSA.

Each parameter present in "Pr2" MENU can be removed or put into "Pr1", user level, by pressing **"SET + ▾"**.

In "Pr2" when a parameter is present in "Pr1" the LED (E.S.) is on.

4.7 HOW TO CHANGE A PARAMETER

To change a parameter value operates as follows:

- Enter the **Programming mode**
- Select the required parameter.
- Press the **"SET"** key to display its value.
- Use **"UP"** or **"DOWN"** to change its value.
- Press **"SET"** to store the new value and move to the following parameter.

TO EXIT: Press **SET + UP** or wait 15s without pressing a key.

NOTE: the set value is stored even when the procedure is exited by waiting the time-out to expire.

4.8 HOW TO LOCK THE KEYBOARD



- Keep pressed for more than 3s the **▲** and **▾** keys.
- The **"POF"** message will be displayed and the keyboard will be locked. At this point it will be possible only to see the set point or the MAX o Min temperature stored
- If a key is pressed more than 3s the **"POF"** message will be displayed.

4.9 TO UNLOCK THE KEYBOARD

Keep pressed together for more than 3s the **▲** and **▾** keys, till the **"Pon"** message will be displayed.

4.10 ON/OFF FUNCTION

TO SWITCH THE INSTRUMENT ON/OFF: If the function is enabled (par. onF=yES), by pressing the SET key for more than 4s the controller is switched OFF. To switch the instrument on again press the SET key.

5. PROBES AND MEASURING RANGE

| Probe | Down Scale | Full Scale |
|-------|-----------------|-----------------|
| NTC | -40°C / -40°F | 110°C / 230°F |
| PTC | -50°C / -58°F | 150°C / 302°F |
| Pt100 | -200°C / -328°F | 600°C / 1112°F |
| TcK | 0°C / 32°F | 1300°C / 1999°F |
| TcJ | 0°C / 32°F | 600°C / 1112°F |
| TcS | 0°C / 32°F | 1400°C / 1999°F |

6. LIST OF PARAMETERS

REGULATION

Hy1 Differential: (-Full Sc. / Full Sc.) Intervention differential for set point. It can be set with positive value or with negative value.

The kind of action (direct or inverse) depends on the S1C parameter (in or di).

LS1 Minimum set point: (Down Sc.+ Set) Sets the minimum acceptable value for the set point.

US1 Maximum set point: (Set+ Full Sc.) Sets the maximum acceptable value for set point.

S1C Action type: S1C=in inverse action (heating/ humidifying /increase pressure); S1C=dir direct action (cooling / dehumidifying /decrease pressure).

AC Anti-short cycle delay: (0+250 sec) Minimum time between the switching off and the following switching on

on Minimum time a stage stays switched ON (0+250 sec)

ono: Minimum time between 2 following switching ON of the same load (0+120 min).

ALARMS

ALC Temperature alarms configuration: it determines if alarms are relative to set point or referred to absolute values.

rE relative to set point; **Ab** absolute temperature

ALL Minimum alarm:

with ALC=rE: relative to set point, (0+|Down Sc.-Set|) this value is subtracted from the set point. The alarm signal is enabled when the probe values goes below the "SET-ALL" value.

with ALC=Ab absolute value, minimum alarm is enabled when the probe values goes below the "ALL" value.

ALU Maximum alarm:

with ALC=rE: alarm relative to set point, (0+|Full Sc.-Set|) Maximum alarm is enabled when the probe values exceeds the "SET+ALU" value.

with ALC=Ab: absolute alarm, (Set+Full Sc.) Maximum alarm is enabled when the probe values exceeds the "ALU" value.

ALH Differential for alarm recovery: (0,1+Full scale) the alarm recovers when probe value is higher than Alarm value + ALH.

ALd Alarm delay:(0+999 min) time interval between the detection of an alarm condition and alarm signalling.

dAO Delay of alarm at start-up: (0+23.5h) time interval between the detection of the alarm condition after instrument power on and alarm signalling.

So1 Relay status with faulty probe: So1=oFF open; So1=on closed.

tbA Status of alarm relay after pushing a key. (XT111C only): oFF = relay disabled; on = relay enabled.

AS Alarm relay configuration (XT111C only): cL = 4-6 terminals open with alarm; oP = 4-6 terminals closed with alarm.

PROBES AND DISPLAY

LCl Start of scale, only with current or voltage input:

(-1999+1999) Adjustment of read out corresponding to 4mA or 0V input signal.

UCI End of scale, only with current or voltage input

(-1999+1999) Adjustment of read out corresponding to 20mA or 1V or 10V input signal.

oPb Probe calibration: (-999+999) allows to adjust possible offset of the probe.

rES Decimal point ON/OFF: (rES=in OFF; rES=dE ON; rES= cE with 2 decimal points, only for current or voltage input) select the resolution of the controller.

NOTE: the decimal point selection is not available on models with thermocouple input.

UdM Measurement unit: it depends on models:

for temperature: °C = Celsius; °F = Fahrenheit.

with 4=20mA, 0=1V, 0=10V input : 0= °C; 1= °F, 2= %RH, 3=bar, 4=PSI, 5=no measurement unit.

PbC Probe selection: it sets the kind of probe. It depends on models

for temperature NTC/PTC: Ptc = PTC; ntc = ntc.

for temperature standard: Pt= Pt100, J = J thermocouple, c = K thermocouple, S = S thermocouple; Ptc = PTC; ntc = ntc.

with 4=20mA, 0=1V, 0=10V input : cur=4=20mA, 0-1 = 0=1V, 10= 0=10V.

P3F Third wire presence for Pt100 probe: for using 2 or 3 wires Pt100 probes: **no** = 2 wires probe; **yES** = 3 wires probe.

DIGITAL INPUT

HES Set point change during during the Energy Saving cycle : (Down Sc./Full Sc.) sets the variation of the set point during the Energy Saving cycle.

i1F Digital input operating mode: configure the digital input function: **c-H** = to invert the kind of action: direct - reverse;

oFF = to switch the controller off.; **AUS** = Not used; **HES** = Energy Saving; **EAL** = generic external alarm; **bAL** = serious external alarm; it switches off the loads.

i1P Digital input polarity:

CL : the digital input is activated by closing the contact;

OP : the digital input is activated by opening the contact

did Digital input alarm delay: (0=255 min) delay between the detection of the external alarm condition (i1F= EAL or i1F = bAL) and its signalling.

OTHER

Adr RS485 serial address (0=247) identifies the instrument within a control or supervising system.

onF Switching ON/OFF enabling from keyboard: (**no** = disabled; **yES**=enabled) It permits the switching ON/OFF of the instrument by pressing the SET key for more than 4s.


Ptb Parameters table: (read only) Shows the code of the parameters map.

rEL Software release: (read only)

Pr2 To access the Pr2 parameter programming menu.

7. INSTALLATION AND MOUNTING

Instrument **XT110C** and **XT111C** shall be mounted on vertical panel, in a 29x71 mm hole, and fixed using the special brackets supplied.



To obtain an IP65 protection grade use the front panel rubber gasket (mod. RG-C) as shown in figure.

The temperature range allowed for correct operation is 0+60 °C. Avoid places subject to strong vibrations, corrosive gases, excessive dirt or humidity. The same recommendations apply to probes. Let air circulate by the cooling holes.

8. ELECTRICAL CONNECTIONS

The instruments are provided with screw terminal block to connect cables with a cross section up to 2,5 mm². Before connecting cables make sure the power supply complies with the instrument's requirements. Separate the input connection cables from the power supply cables, from the outputs and the power connections. Do not exceed the maximum current allowed on each relay, in case of heavier loads use a suitable external relay.

9. SERIAL CONNECTIONS

All models can be connected to the monitoring and supervising system XJ500 using the serial port. The external XJ485 serial module to interface the instrument with the monitoring and supervising system XJ500 is required.

The standard ModBus RTU protocol is used.

NOTE: Instruments with current or voltage input and 230V or 115V supply, cannot be connected to the XJ485 serial module.

10. HOW TO USE THE HOT KEY

10.1 HOW TO PROGRAM A HOT KEY FROM THE INSTRUMENT (UPLOAD)

1. Program one controller with the front keypad.
2. When the controller is **ON**, insert the **"Hot key"** and push **▲** key; the **"uPL"** message appears followed a by flashing **"End"**
3. Push **"SET"** key and the **End** will stop flashing.
4. **Turn OFF** the instrument remove the **"Hot Key"**, then turn it **ON** again.

NOTE: the "Err" message is displayed for failed programming. In this case push again **▲** key if you want to restart the upload again or remove the **"Hot key"** to abort the operation.

10.2 HOW TO PROGRAM AN INSTRUMENT USING A HOT KEY (DOWNLOAD)

1. Turn OFF the instrument.
2. Insert a **programmed "Hot Key"** into the **5 PIN** receptacle and then turn the Controller ON.
3. Automatically the parameter list of the **"Hot Key"** is downloaded into the Controller memory, the **"doL"** message is blinking followed a by flashing **"End"**.
4. After 10 seconds the instrument will restart working with the new parameters.
5. Remove the **"Hot Key"**.

NOTE the message "Err" is displayed for failed programming. In this case turn the unit off and then on if you want to restart the download again or remove the **"Hot key"** to abort the operation.

11. DIGITAL INPUT

XT110C and XT111C have 1 free contact digital input. It is programmable in 5 different configurations by the **"i1F"** parameter.

11.1 INVERT THE KIND OF ACTION: HEATING-COOLING (I1F = C-H)

This function allows to invert the regulation of the controller: from direct to inverse and viceversa.

11.2 REMOTE ON/OFF (I1F = OFF)

This function allows to switch ON and OFF the instrument.

11.3 GENERIC ALARM (I1F = EAL)

As soon as the digital input is activated the unit will wait for **"did"** time delay before signalling the **"EAL"** alarm message. The outputs status don't change. The alarm stops just after the digital input is deactivated.

11.4 SERIOUS ALARM MODE (I1F = BAL)

When the digital input is activated, the unit will wait for **"did"** delay before signalling the **"bAL"** alarm message. The relay outputs are switched OFF. The alarm will stop as soon as the digital input is deactivated.

11.5 ENERGY SAVING (I1F = HES)

The Energy Saving function allows to change the set point1 value as the result of the SET1+ HES (parameter) sum. This function is enabled until the digital input is activated.

12. ALARM SIGNALS

| Message | Cause | Outputs |
|---------|-------------------------|--|
| "PFo" | Probe broken or absence | Alarm output ON; Output according to parameter "So1" |
| "PFc" | Probe short circuited | Alarm output ON; Output according to parameter "So1" |
| "HA" | Maximum alarm | Alarm output ON; Other outputs unchanged. |
| "LA" | Minimum alarm | Alarm output ON; Other outputs unchanged. |
| "EAL" | External alarm | Output unchanged. |
| "bAL" | Serious external alarm | Output OFF. |

12.1 ALARM RELAY STATUS (XT111C)

| Status of the instrument | AS = CL | AS = oP |
|--------------------------|------------|------------|
| Instrument off | 4-6 closed | 4-6 closed |
| Normal operating | 4-6 closed | 4-6 open |
| Alarm present | 4-6 open | 4-6 closed |

12.2 SILENCING BUZZER / ALARM RELAY OUTPUT

Once the alarm signal is detected the buzzer, if present, can be disabled by pressing any key.

XT111C: the alarm relay status depends on the **tbA** parameter: with **tbA=yES** the relay is disabled by pressing any key, with **tbA=no** the alarm relay remains enabled as long as the alarm lasts. The display signal remains as long as the alarm condition remains.

12.3 ALARM RECOVERY

Probe alarms **"PFo"**, **"PFc"** start few seconds after the fault in the probe; they automatically stop few seconds after the probe restarts normal operation. Check connections before replacing the probe. Max. and min. alarms **"HA"** and **"LA"** automatically stop as soon as the variable returns to normal values. Alarms **"bAL"** and **"EAL"** recover as soon as the digital input is disabled.

13. TECHNICAL DATA

Housing: self extinguishing ABS.

Case: frontal 32x74 mm; depth 60mm;

Mounting: panel mounting in a 71x29 mm panel cut-out.

Protection: IP20.

Frontal protection: IP65 with frontal gasket RG-C (optional).

Connections: Screw terminal block ≤ 2,5 mm² heat-resistant wiring.

Power supply: 12Vac/dc, ±10% or: 24Vac/dc ± 10%

or 230Vac ± 10%, 50/60Hz or 110Vac, ± 10%, 50/60Hz

Power absorption: 3VA max.

Display: 3 ½ digits, red LED

Inputs: according to the order: NTC/PTC or NTC/PTC /Pt100

/Thermocouple J, K, S or 4=20mA/ 0=1V / 0=10V

Relay outputs: Load relay SPDT 8(3)A, 250Vac

Alarm: (XT111C) relay SPDT 8(3)A, 250Vac

Other output: buzzer (optional)

Kind of action: 1B **Pollution grade:** normal. **Software class:** A.

Data storing: on the non-volatile memory (EEPROM).

Operating temperature: 0+60 °C (32+140°F).

Storage temperature: -30+85 °C (-22+185°F).


Relative humidity: 20+85% (no condensing)

Measuring and regulation range: according to the probe

Controller Accuracy a 25°C: better than ±0,5% of full scale


14. CONNECTIONS

14.1 XT110C – 12V AC/DC OR 24V AC/DC

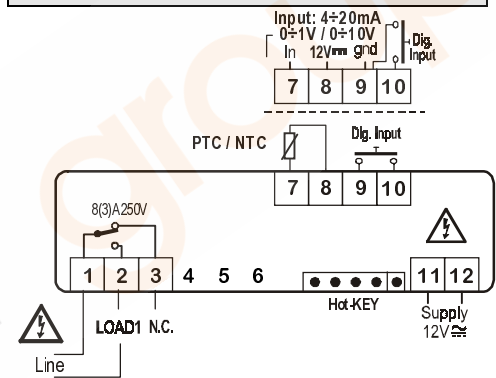


Probe: Pt100= 7 – 9 (8); Thermocouple J, K, S = 7(+); 9(-)
24Vac/dc supply: 11-12

14.2 XT110C – 230V AC OR 115V AC

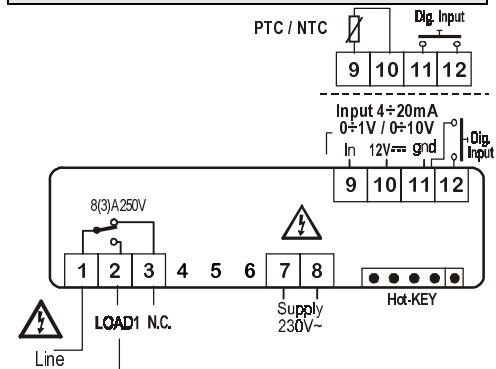


Pt100=9 – 11 (10); Thermocouple J, K, S = 9(+)- 11(-)
115Vac supply: 7-8

14.3 XT111C – 12VAC/DC OR 24VAC/DC

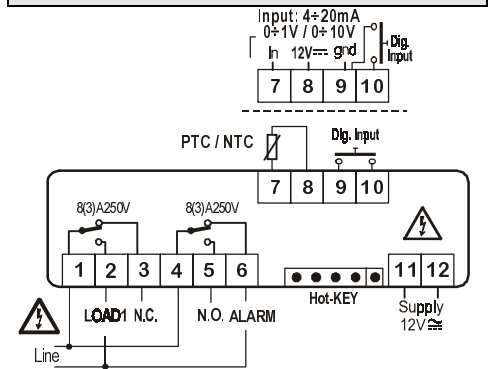

Probe: Pt100= 7 – 9 (8); Thermocouple J, K, S = 7(+); 9(-)
24Vac/dc supply: 11-12

14.4 XT111C – 230V AC OR 115V AC

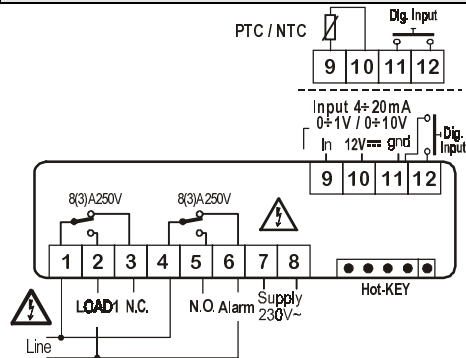

Probe: Pt1 00=9-11 (10); Thermocouple J, K, S= 9(+)- 11(-)
115Vac supply: 7-8

15. DEFAULT SETTING VALUES

| COD | Name | Range | °C/°F | Lev |
|------------------|--|---|----------|-----|
| Set | Set point | LS1+US1 | 0/32 | - |
| Hy1 | Differential | -Full Sc./ Full Sc. | -1/-2 | Pr1 |
| LS1 | Minimum set point | Down Sc./ Set | min | Pr2 |
| US1 | Maximum set point | Set/ Full Sc. | max | Pr2 |
| S1C | Action type output | in= Inverse; dir=direct | in | Pr2 |
| Ac | Anti-short cycle delay: | 0+250 sec | 0 | Pr2 |
| on | Minimum time a stage stays switched ON | 0+250 sec | 0 | Pr2 |
| ono | Minimum time between 2 following switching ON of the same load | 0+120 min | 0 | Pr2 |
| ALC | Alarm configuration | rE=relat.; Ab= absolute | rE | Pr2 |
| ALL | Minimum alarm (ALC=rE) (ALC=Ab) | 0 + Start Sc.-Set Start Sc.+ ALU | 10.0/ 20 | Pr2 |
| ALU | Maximum alarm (ALC=rE) (ALC=Ab) | 0 + Full Sc.-Set ALL+ Full Scale | 10.0/ 20 | Pr2 |
| ALH | Alarm recovery differential | 0+Full scale | 2.0/4 | Pr2 |
| ALd | Alarm delay | 0+999 min | 15 | Pr2 |
| dAO | Alarm delay at start up | 0+23h 50min | 1.3 | Pr2 |
| So1 | Output status with faulty pr. | oFF=open on=closed | oFF | Pr2 |
| tbA ¹ | Alarm relay disabling | no; yES | yES | Pr2 |
| AS ¹ | Alarm relay polarity | CL=oP | oP | Pr2 |
| Lci ² | Start scale with current or voltage input | -1999+1999 | various | Pr1 |
| Uci ² | End scale with current or voltage input | -1999+1999 | various | Pr1 |
| OPb | Probe calibration | -Full Sc./ Full Sc. | 0.0 | Pr1 |
| rES | Resolution | in=NO; dE=0.1; cE=0.01 | in | Pr2 |
| UdM | Measurement unit (temp.) (current/voltage) | °C=°C; °F=°F; 0=°C; 1=°F; 2=RH; 3=bar; 4=PSI; 5=off | various | Pr1 |
| PbC | Kind of probe | Pt=Pt100; J=tcJ; c= tck; S=tcS; Ptc=PTC; ntc= NTC; 0-1=0+1V; 10= 0+10V; cur=0+20mA | various | Pr1 |
| P3F | 3 rd wire presence | no=2 wires; yES=3 wires | no | Pr2 |
| HES | Energy saving differential | Down Sc./ Full Sc. | 0.0 | Pr2 |
| i1F | Digital input configuration | c-H / oFF / AuS / HES / EAL / bAL | EAL | Pr2 |
| i1P | Digital input polarity | cL=closed; oP=open | cL | Pr2 |
| did | Alarm delay for dig. input | 0+120m | 0 | Pr2 |
| Adr | Serial address | 0+247 | 1 | Pr2 |
| OnF | oFF function enabling | no=not enabled; yES=e enabled | no | Pr2 |
| Ptb | Parameter table | Readable only | -- | Pr2 |
| rEL | Software release | Readable only | --- | Pr2 |
| Pr2 | To access the Pr2 | Readable only | 321 | Pr1 |

¹ Only for XT111C; ² Only for instrument with 4+20mA or 0+1V or 0+10V