

# AC axial fan

sickled blades (S series)

**ErP2015**  
EXCEEDS THE NORM

## Nominal data

Type	A6E450-AN06-20		
Motor	M6E094-FA		
Phase		1~	1~
Nominal voltage	VAC	230	230
Frequency	Hz	50	60
Type of data definition		ml	ml
Valid for approval / standard		CE	CE
Speed	min <sup>-1</sup>	880	970
Power input	W	155	215
Current draw	A	0.65	0.95
Motor capacitor	µF	5	5
Capacitor voltage	VDB	400	400
Capacitor standard		P0 (CE)	P0 (CE)
Max. back pressure	Pa	55	65
Min. ambient temperature	°C	-40	-40
Max. ambient temperature	°C	70	70
Starting current	A	1.2	1.11

ml = Max. load · me = Max. efficiency · fa = Running at free air · cs = Customer specs · cu = Customer unit  
Subject to alterations

## Data according to ErP directive

			Actual	Request 2015
Installation category	A	Overall efficiency $\eta_{es}$	% 28.5	28.5
Efficiency category	Static	Efficiency grade N	40	40
Variable speed drive	No	Power input $P_e$	kW 0.15	
Specific ratio*	1.00	Air flow $q_v$	m <sup>3</sup> /h 3110	
		Pressure increase $p_{fs}$	Pa 48	
		Speed n	min <sup>-1</sup> 885	

Data definition with optimum efficiency. LU-107643  
The ErP data is determined using a motor-impeller combination in a standardised measurement configuration



# AC axial fan

sickled blades (S series)

## Technical features


Mass	5.9 kg
Size	450 mm
Surface of rotor	Coated in black
Material of terminal box	ABS plastic
Material of blades	Press-fitted sheet steel blank, sprayed with PP plastic
Number of blades	5
Direction of air flow	"V"
Direction of rotation	Counter-clockwise, seen on rotor
Type of protection	IP 54
Insulation class	"F"
Humidity class	F4-1
Max. permissible ambient motor temp. (transp./ storage)	+80 °C
Min. permissible ambient motor temp. (transp./storage)	-40 °C
Mounting position	Shaft horizontal or rotor on bottom; rotor on top on request
Condensate discharge holes	Rotor-side
Operation mode	S1
Motor bearing	Ball bearing
Touch current acc. IEC 60990 (measuring network Fig. 4, TN system)	<= 3.5 mA
Electrical leads	Via terminal box, integrated capacitor connected via terminal box
Motor protection	Thermal overload protector (TOP) brought out
Protection class	I (if protective earth is connected by customer)
Motor capacitor according to EN 60252-1 in safety protection class	P0/S0
Product conforming to standard	EN 60034-1 (2010); CE



# AC axial fan

sickled blades (S series)


Product drawing

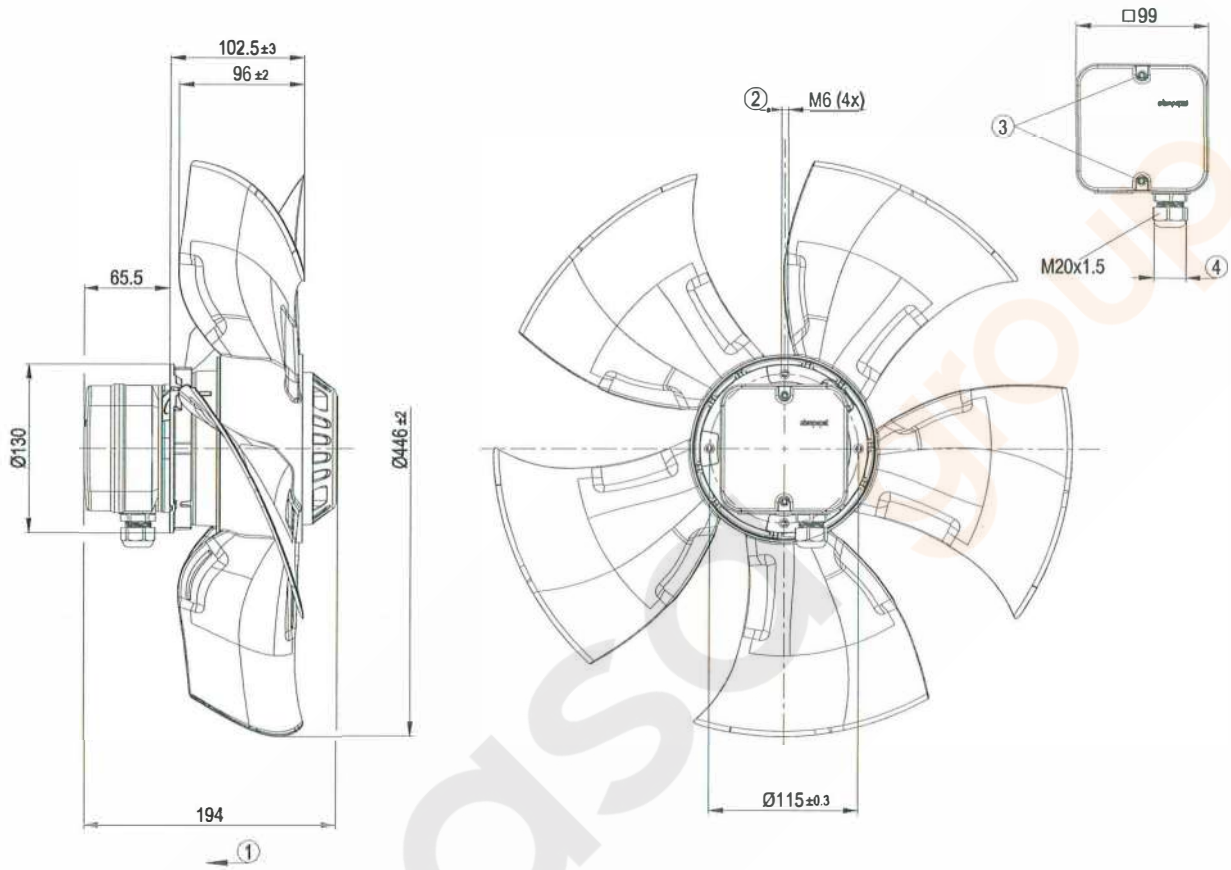

- 1 Direction of air flow "V"
- 2 Thread reach max. 12 mm
- 3 Tightening torque 0.8±0.15 Nm
- 4 Cable diameter: min. 6 mm, max. 12 mm; tightening torque 2±0.2 Nm



## Connection screen




L = U1 = blue  
PE green / yellow

Z brown  
TOP grey

N = U2 = black



## Charts: Air flow 50 Hz

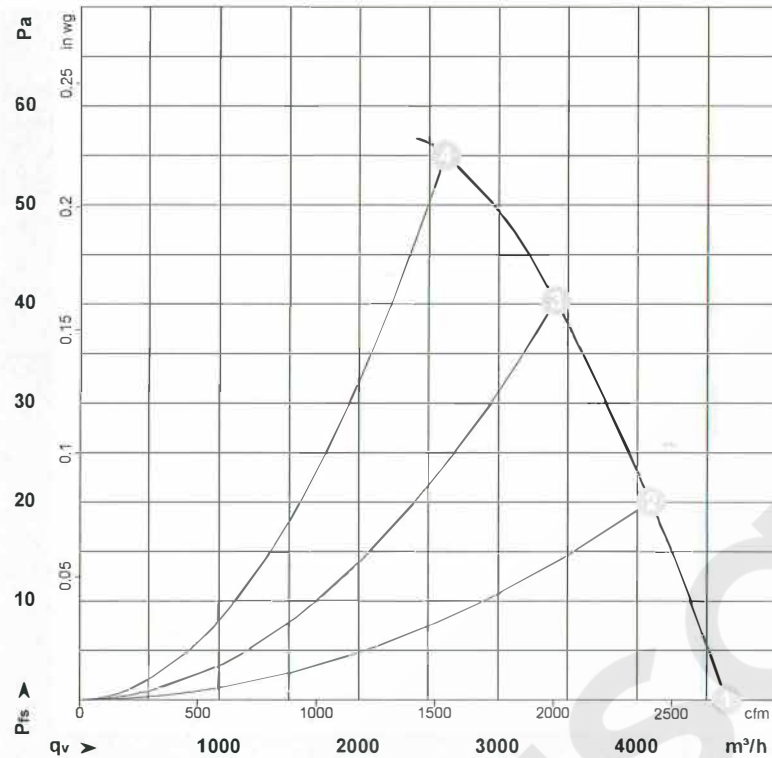

$\rho = 1,15 \text{ kg/m}^3 \pm 2\%$

Measurement: LU-167643

Air performance measured as per ISO 5801 Installation category A. For detailed information on the measuring set-up, please contact ebm-papst. Suction-side noise levels: LwA measured as per ISO 13347 / LpA measured with 1m distance to fan axis. The values given are valid under the measuring conditions mentioned above and may vary according to the actual installation situation. With any deviation from the standard set-up, the specific values have to be checked and reviewed with the unit installed.


### Measured values

	U	f	n	P <sub>e</sub>	I	qv	p <sub>f<sub>s</sub></sub>
	V	Hz	min <sup>-1</sup>	W	A	m <sup>3</sup> /h	Pa
1	230	50	910	136	0.60	4640	0
2	230	50	900	143	0.63	4100	20
3	230	50	885	150	0.65	3415	40
4	230	50	880	155	0.65	2620	55

U = Supply voltage · f = Frequency · n = Speed · P<sub>e</sub> = Power input · I = Current draw · qv = Air flow · p<sub>f<sub>s</sub></sub> = Pressure increase



## Charts: Air flow 60 Hz

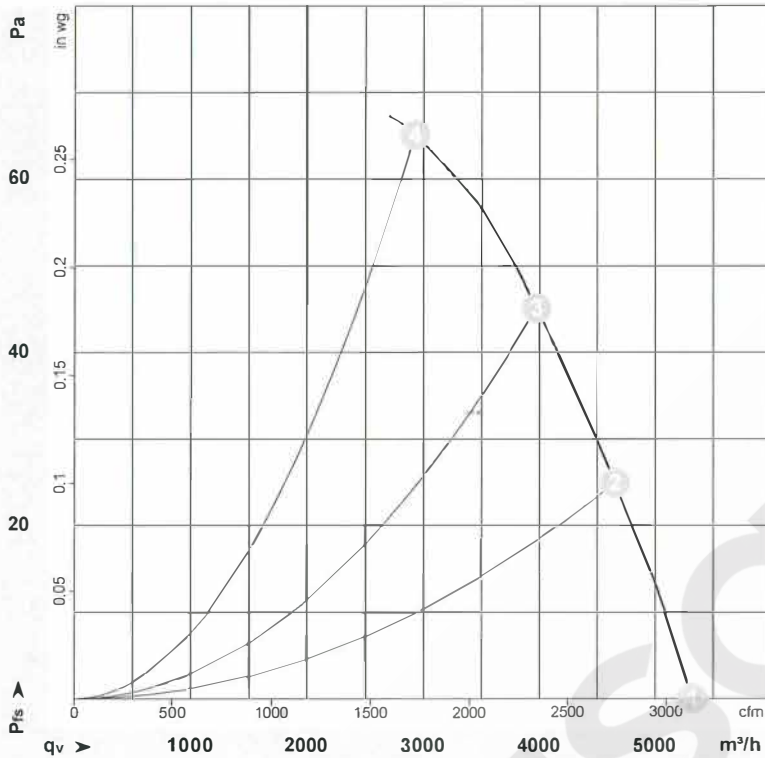

$\rho = 1,15 \text{ kg/m}^3 \pm 2\%$

Measurement: LU-167866

Air performance measured as per ISO 5801 Installation category A. For detailed information on the measuring set-up, please contact ebm-papst. Suction-side noise levels: LwA measured as per ISO 13347 / LpA measured with 1m distance to fan axis. The values given are valid under the measuring conditions mentioned above and may vary according to the actual installation situation. With any deviation from the standard set-up, the specific values have to be checked and reviewed with the unit installed.

### Measured values

	U	f	n	P <sub>e</sub>	I	qv	P <sub>fs</sub>
	V	Hz	min <sup>-1</sup>	W	A	m <sup>3</sup> /h	Pa
1	230	60	1040	198	0.87	5325	0
2	230	60	1015	206	0.90	4655	25
3	230	60	995	212	0.92	3975	45
4	230	60	970	215	0.95	2925	65

U = Supply voltage · f = Frequency · n = Speed · P<sub>e</sub> = Power input · I = Current draw · qv = Air flow · P<sub>fs</sub> = Pressure increase

