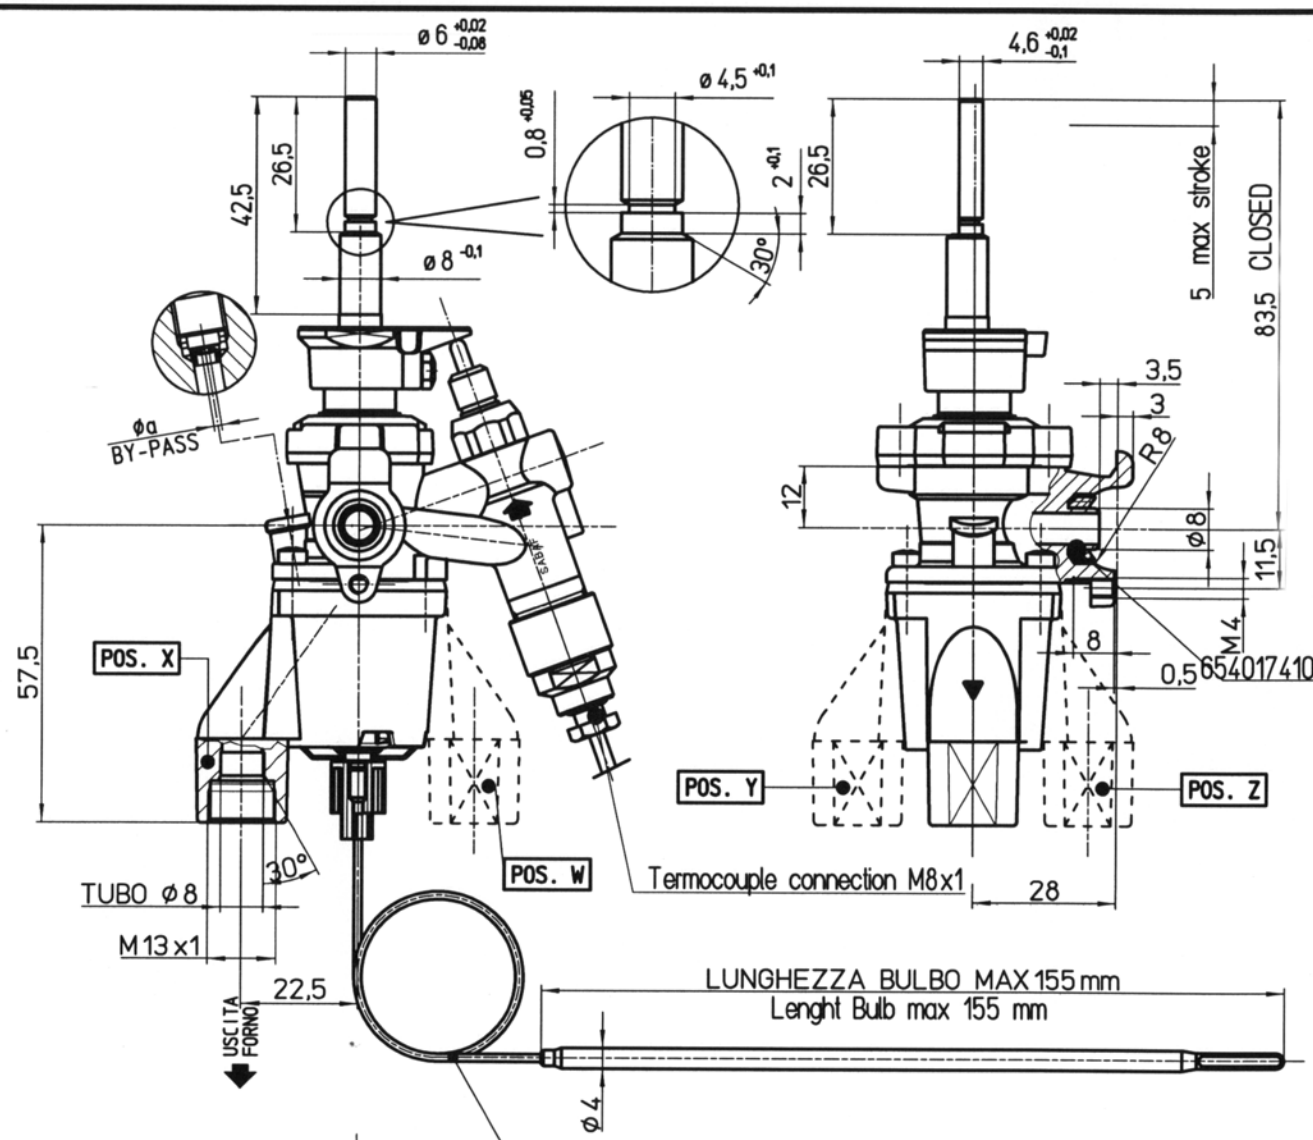

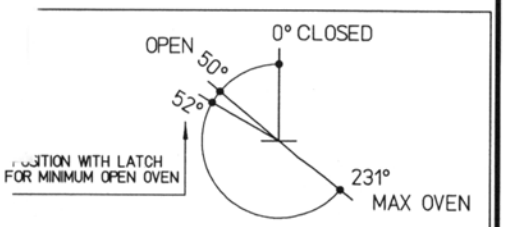

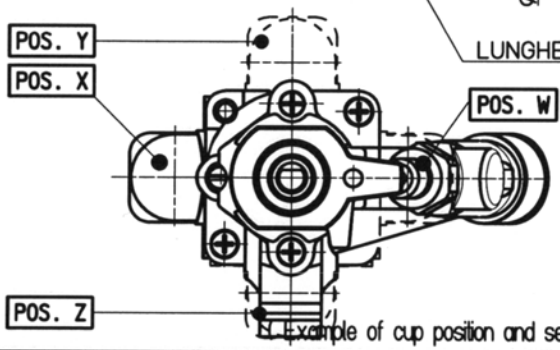

(Example of cup position and setting temperature: 623898910xxx XA)

CUP POSITION	TYPE	TEMP. °C	Ø a BY-PASS (mm)	Ø REG. EQUIV.	CAP SCREWS COLOUR	SABAF NUMBER		CUP POSITION CODE	SETTING TEMPER. CODE
	SETTING TEMPERATURE (ROTATION 231°)								
-	-	-	-	-	-	-			
-	-	-	-	-	-	-			
-	-	-	-	-	-	-			
-	-	-	-	-	-	-			
-	-	-	-	-	-	-			
X	C	300	0,52	-	BIANCO	671		0	0 3
X	B	278	0,52	-	ROSSO	671		0	0 2
X	A	278	0,70	-	GIALLO	671		0	0 1

MODEL 20

EC TYPE EXAMINATION CERTIFICATE n° 51A018 EEC DIRECTIVE 90/396

CERTIFICATE OF COMPLIANCE n° 1091812

CERTIFICATE OF COMPLIANCE n° ---

TYPE: R1 (180 mA / 60 mA)

MAX FIXING TORQUE VALUES SEE ASSEMBLY INSTRUCTION AND TABLE S-SAQ-005

This drawing is the sole property of SABAF S.p.A. The information illustrated and disclosed herein is confidential to and proprietary to SABAF S.p.A. No use of the information illustrated and disclosed herein or making of a reproduction hereof without the express written permission of SABAF S.p.A. is permitted.

CODE 623898910xxx

TITLE
TERM V 1V CE20
FSD THERMOSTAT 1 OUTLET
ASSIEME (IN POSIZIONE DI CHIUSO)
ASSEMBLY (IN OFF POSITION)

NOTE
SEZIONATO: vedi TAV.02

SABAF NR.	SCALE	DRAWING NR.
0019	1:1	623898910xxx
DRAWN	DATE	
PASETTI R.	31-01-2006	

SABAF Ospitaletto – BRESCIA

SHEET 01 REV. 00

DATE | DRAWN | LAST REVISION